


Appendix F.1 Indicative Sampling Point Selection of 2,500 L Underground Fuel Tank of Emergency Power Supply System No.1 (i.e. **BH1**)

Sample	Sampling Point Selection Strategy
Sand	0.5 m, 1.5 m Below Ground Surface and bottom level inside the concrete chamber
Soil	Right underneath concrete chamber

Legend:

-  Sand Sampling Point
-  Soil Sampling Point

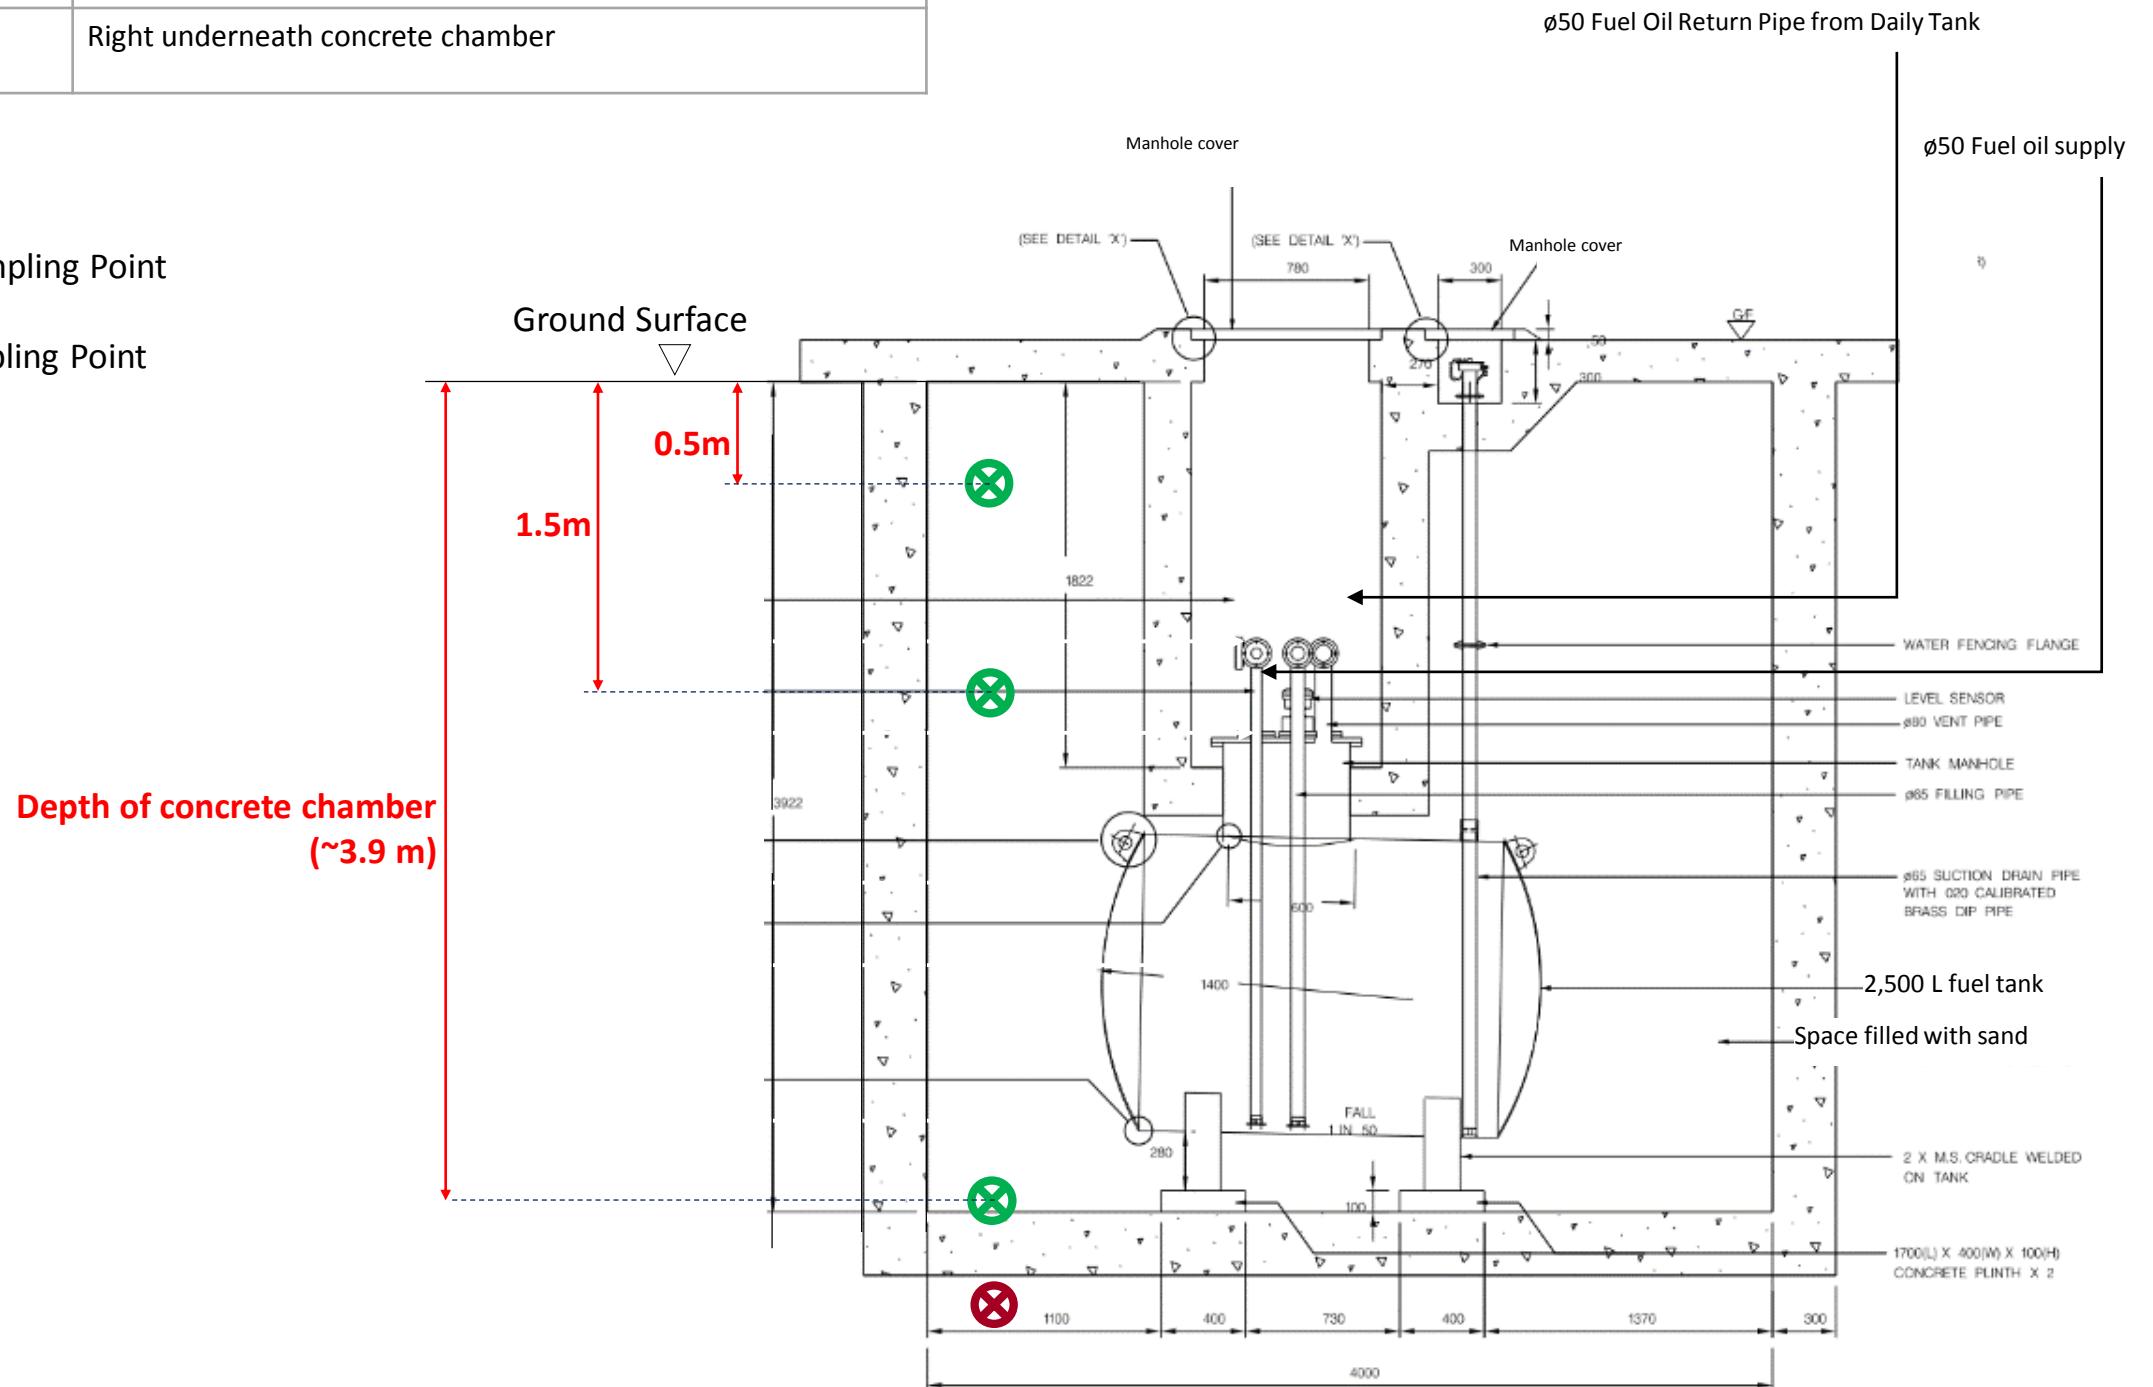

Indicative Sampling Point Selection of 2,500 L Underground Fuel Tank of Emergency Power Supply System No.1 (i.e. **BH1**)