




Appendix F.5 Indicative Sampling Point Selection of Underground Pipeline Trench of Emergency Power Supply System No.4 (i.e. **HS3**)

Annotation of Sampling Point	Type of Sampling Point (Curvature/ Additional)	Sample	
		At the level of fuel pipelines (Within Concrete Trench)	Right underneath concrete trench
HS3-S1	Curvature	Sand	Soil
HS3-S2	Additional		-
HS3-S3	Curvature		Soil
HS3-S4	Curvature		Soil
HS3-S5	Additional		-
HS3-S6	Additional		-
HS3-S7	Curvature		Soil

**LEGEND:**

-  Curvature Sampling Point
-  Additional Sampling Point

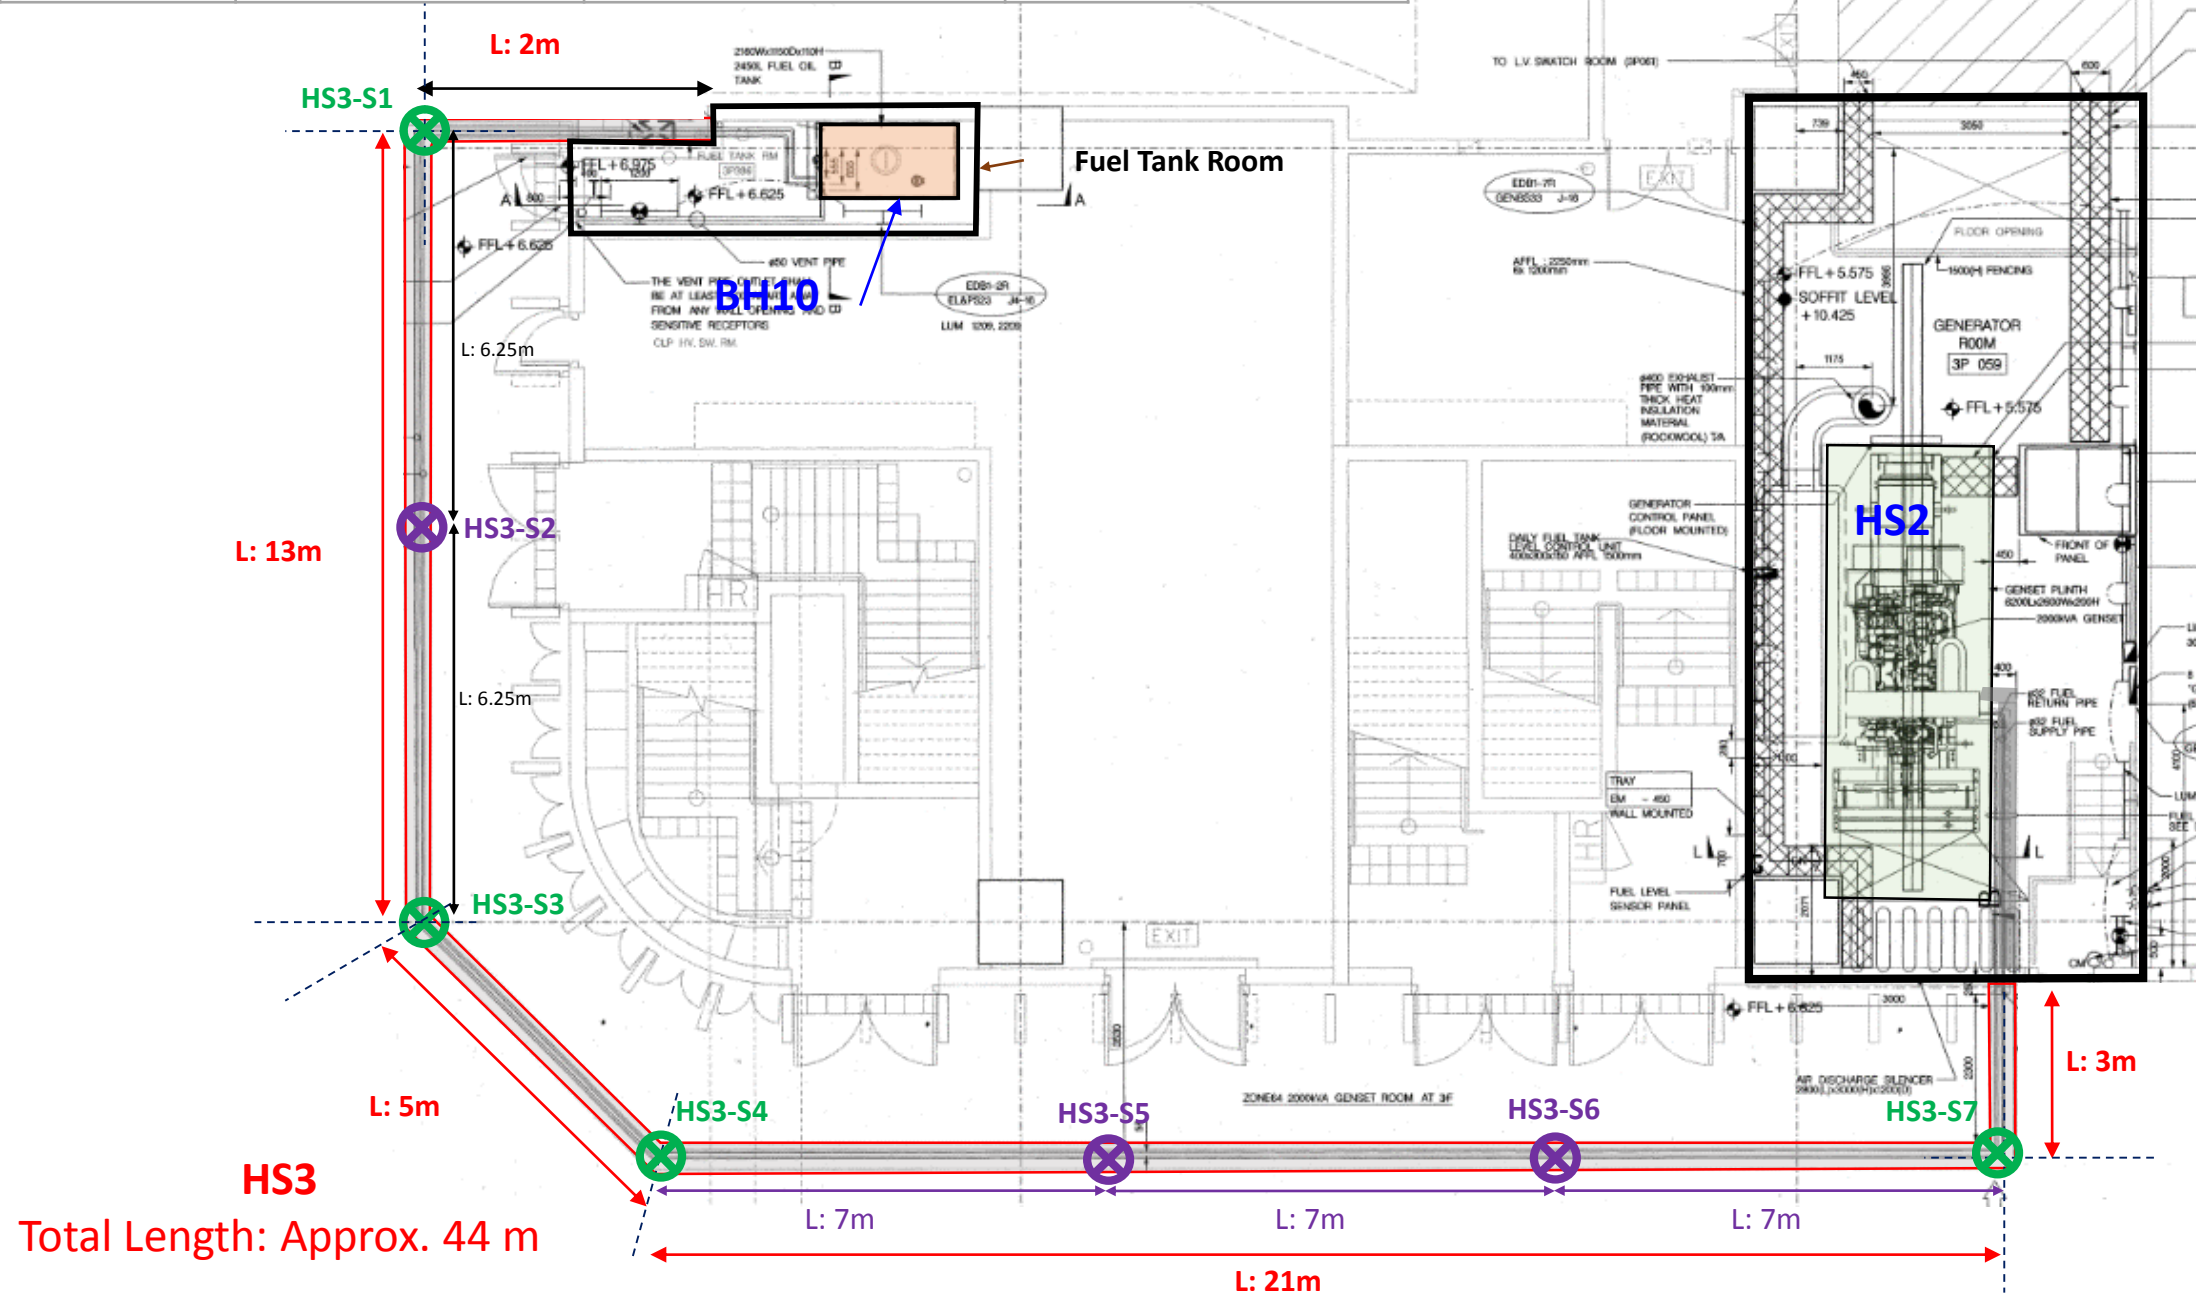

Indicative Sampling Point Selection of Underground Pipeline Trench of Emergency Power Supply System No.4 (i.e. **HS3**)